


SECTION B-B

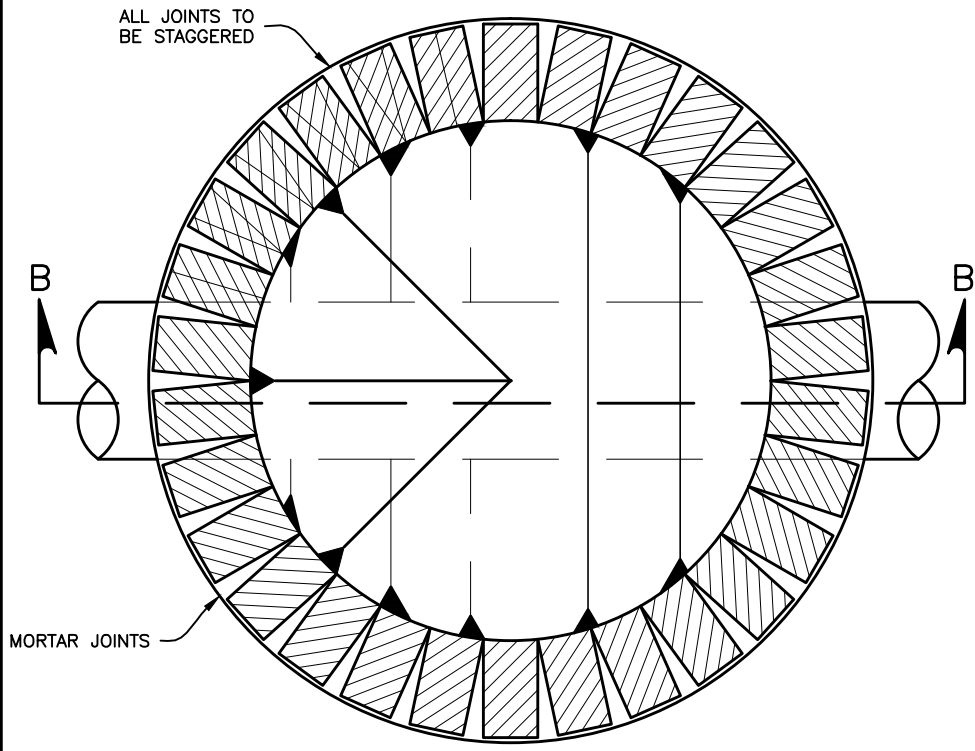

SECTION A-A

NOTES:

1. PIPES DRAINING INTO INLET SHALL BE PLACED 2" ABOVE ELEVATION OF OUTLET PIPE.
2. MAXIMUM SIZE OF PIPE TO BE USED WITH INLET WILL BE 24".
3. OUTLET PIPE TO BE PLACED AT FRONT OR BACK OF INLET.
4. IF PIPE IS PLACED UNDER PAVEMENT AND THE COVER FROM TOP OF PIPE TO BOTTOM OF PAVEMENT IS 30" OR LESS, CLASS "A" CONCRETE ENCASEMENT WILL BE REQUIRED. PER CMS 901.12.
5. INLETS SHALL BE BUILT OF BRICK, PRECAST SOLID CONCRETE BLOCKS, CAST IN PLACE CONCRETE OR PRE-CAST CONCRETE.
6. PRE-CAST WALLS SHALL HAVE A MIN. THICKNESS OF 5" AND BE SUFFICIENTLY REINFORCED TO PERMIT SHIPPING AND HANDLING WITHOUT DAMAGE.
7. PRECAST INLETS SHALL BE IN ACCORDANCE WITH ASTM C913.

CITY OF COLUMBUS, OHIO DEPARTMENT OF PUBLIC UTILITIES DIVISION OF SEWERAGE & DRAINAGE	CURB INLET	STANDARD DRAWING AA-S120
<i>John J. Newson</i> SSES MANAGER		REVISED 7/9/12
		PAGE 1 / 1