


**NOTE:**

Unless otherwise approved by the Division of Water, a meter box installation shall be required when the meter cannot be placed in a Division of Water approved structure within 150 feet of the curb stop.

- Ford meter box W3PR-BR
- Meter Box Cover OR
- DOW Approved Equal
- Ford meter box WA3LP-BR
- Plastic Lid for Iron Frame
- OR DOW Approved Equal
- Ford meter box W3BPD
- Plastic Inner Lid OR
- DOW Approved Equal

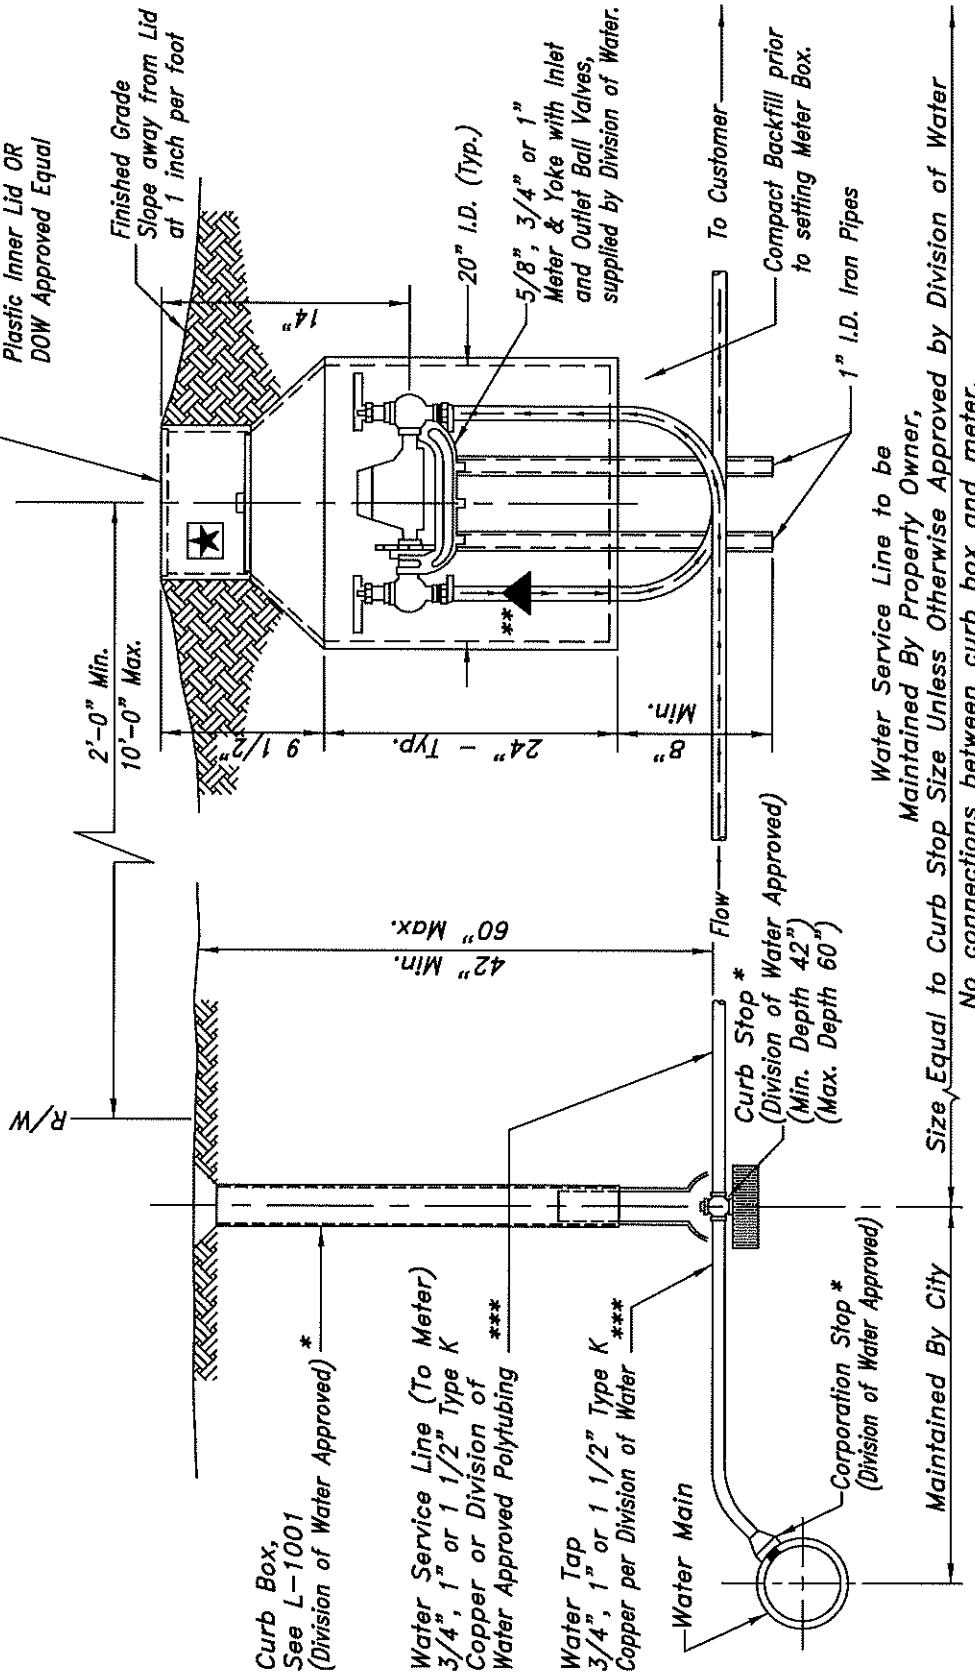

Water Service Line to be Maintained By Property Owner, Size Equal to Curb Stop Size Unless Otherwise Approved by Division of Water  
No connections between curb box and meter.

**\* NOTE:**

For reference in placing new corporation stops, curb stops and curb boxes see L-9901.

**\*\* NOTE:**

If the Meter size is less than the Water Service Line size, any Reducers/Incrasers shall be placed on the vertical outlet piping inside of the Meter Box.

**\*\*\* NOTE:**

Pipe Shall Be Copper Tubing Size (C.T.S.)

DOW Installed Radio Transmitter

CITY OF COLUMBUS  
DEPARTMENT OF PUBLIC UTILITIES  
DIVISION OF WATER

APPROVED:  
*Navalyn Pottash*  
ADMINISTRATOR

5/17/21  
DATE

STANDARD DETAIL  
METER BOX INSTALLATION  
5/8" THRU 1" METER

